



NOTES

1. ALL RAINWATER PIPEWORK TO BE PLASTIC.
2. ALL RAINWATER PIPEWORK TO BE INSULATED & LABELLED "NON-POTABLE" OR SIMILAR.
3. CHECK METERS TO BE PROVIDED BY METERING COMPANY – FREE ISSUE.

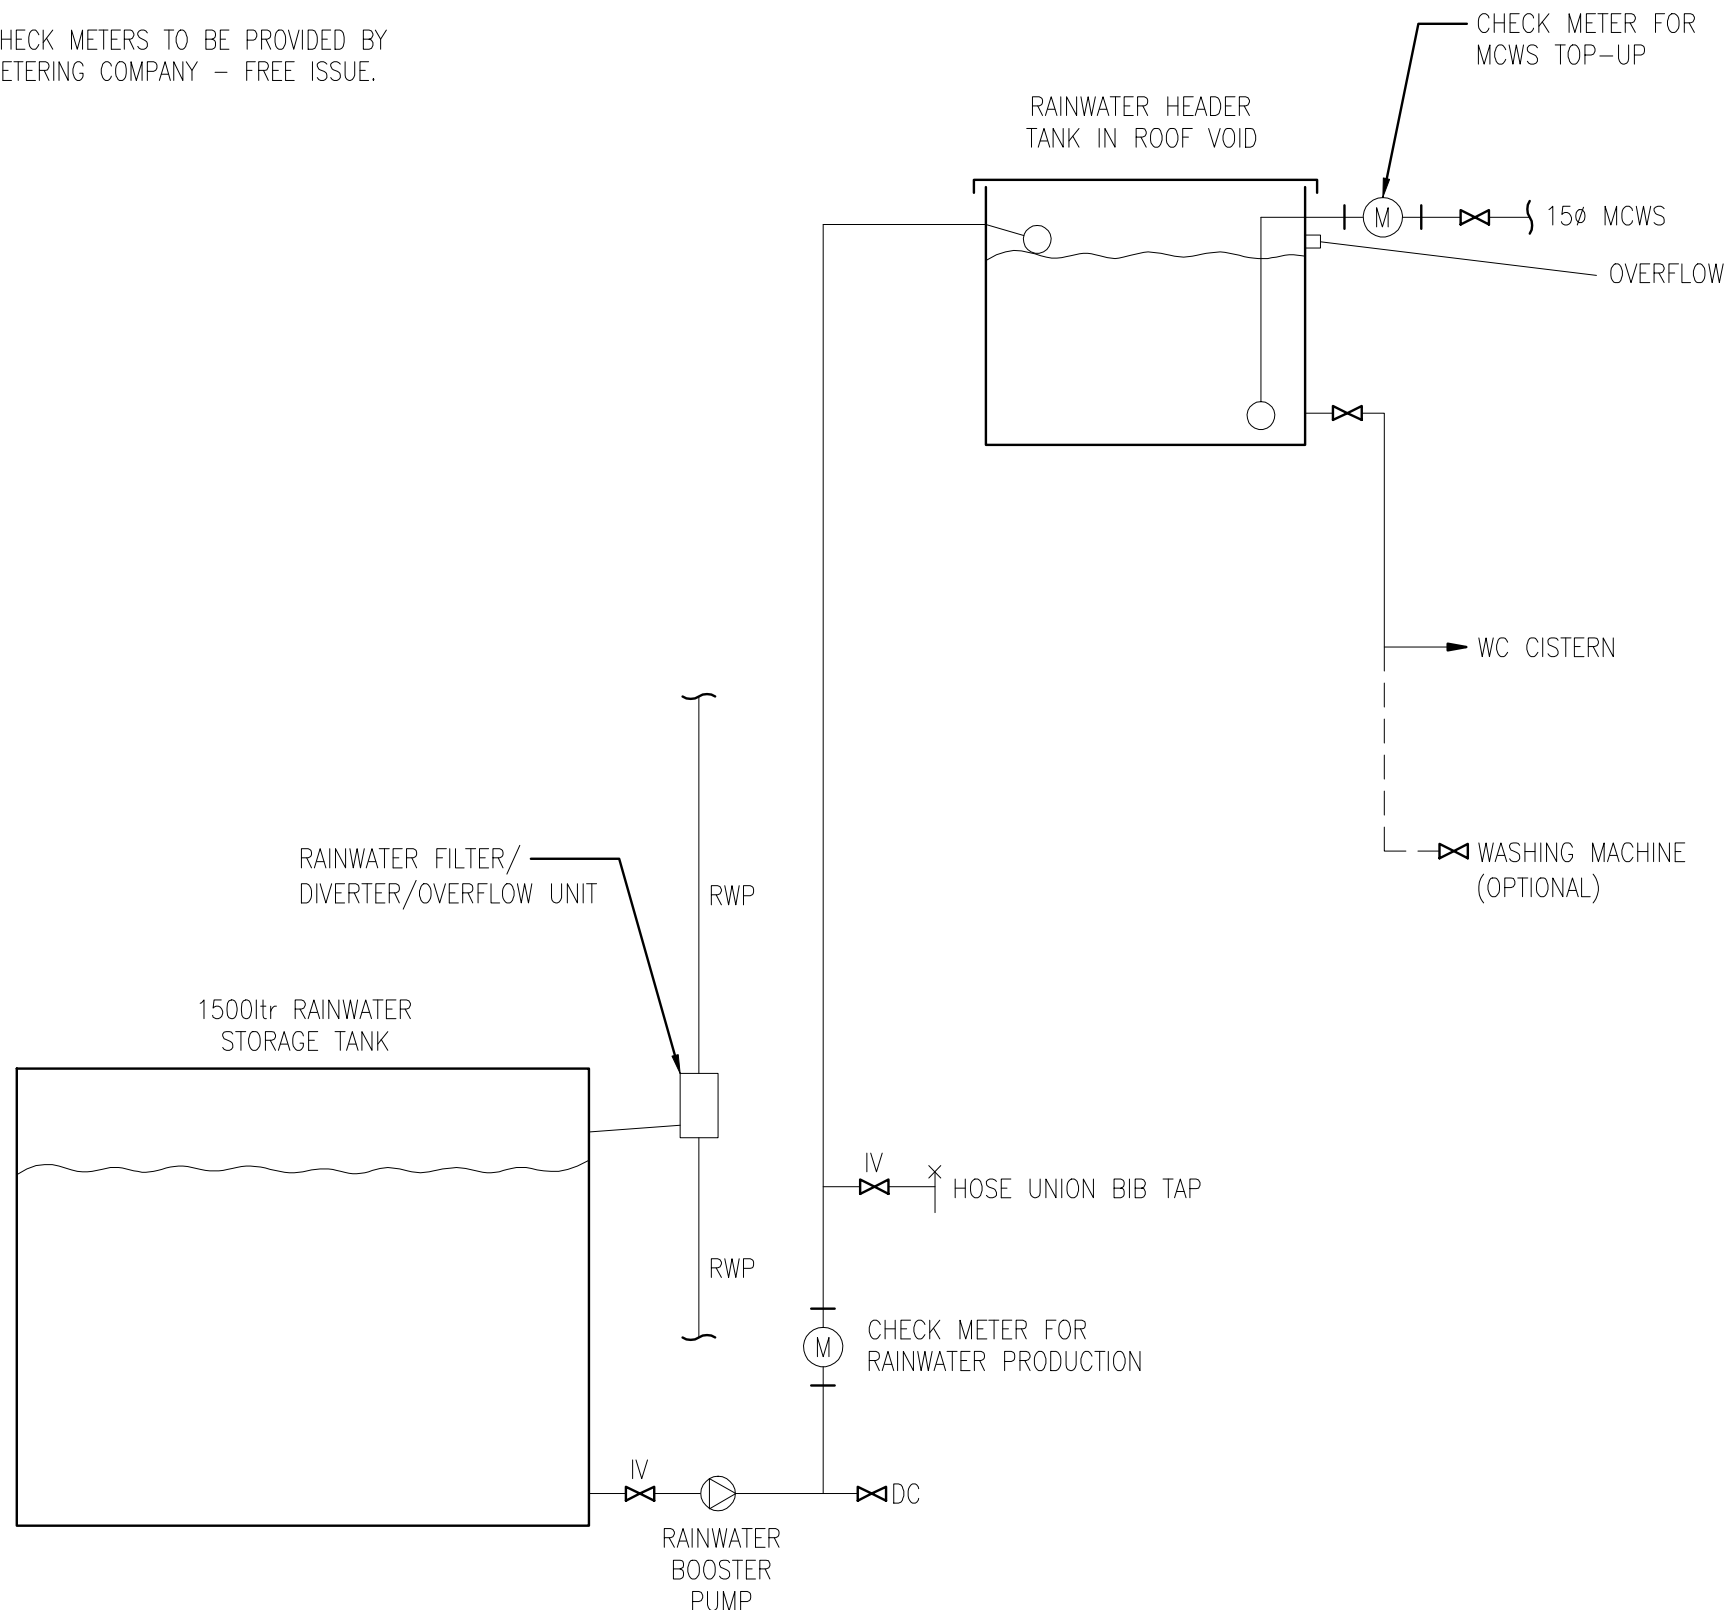

P1	JAN 2011	PRELIMINARY ISSUE
Revision	Date	Remarks
<b>STATUS</b>		
<b>PRELIMINARY</b>		
 <p>The Old Mill Main Road Orpington Kent BR5 3HS Tel: 01689 887600 Fax: 01689 887610 Info@stapletech.co.uk www.stapletech.co.uk</p>		
<small>stapletech Ltd owns the copyright of this document which is supplied in confidence and must not be used for any purpose other than that which it is supplied and must not be reproduced without permission in writing from the owners.</small> © stapletech Ltd.		
<b>CUSTOMER</b>		
CATALYST HOUSING GROUP EALING GATEWAY 26-30 UXBRIDGE ROAD EALING W5 2AU		
<b>PROJECT</b>		
CATALYST ECO REFURBS 47 ADDINGTON ROAD AND 12 PALMER PARK ROAD, READING		
<b>TITLE</b>		
RAINWATER HARVESTING SYSTEM SCHEMATIC		
<b>SCALE</b>	<b>DRG No</b>	
NTS	PM578/M/403	
<b>DATE</b>	<b>REVISION</b>	
JAN 2011	P1	
<b>ENGINEER</b>	CAD	APPROVED
DXM	PAA	MEO